



PEDESTAL JUNCTION CABINET

UGS


TYPICAL PEDESTAL JUNCTION CABINET LOCATIONS




SLAB BOX SHOWING CABINET BACK TO BACK

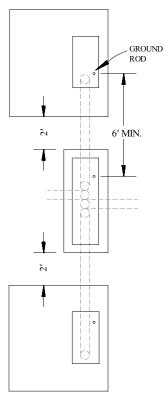

TRANSFORMER PADS SHOWING CABINET IN BETWEEN



TRANSFORMER PAD SHOWING CABINET SIDE TO SIDE



TRANSFORMER PAD SHOWING CABINET BACK TO SIDE

Notes:

- 1. No telecommunication conduit shall be installed in the Pedestal Junction Cabinet.
- 2. Barrier posts may be required at the discretion of the Department Inspector.
- 3. Typically, two ground rods 5/8" x 8' copper shall be installed 6' minimum on center.

Issued: 2/03

Rev: 1